

SOUND SOLUTIONS

ROOFTOP UNITS


No. 5

One of the most difficult problems which confronts HVAC mechanical engineers is the problem of controlling noise and vibration from rooftop units. Rooftop units are usually prepackaged, self-contained, air conditioning or refrigeration units which are mounted on top of the roof (air conditioning units are usually mounted on a factory built or site built curb). Rooftop units are common in warehouse, low-rise office, and retail structures, but they can also be found in hospitals, schools, and other commercial buildings.

There are two acoustical problems which are commonly found with rooftop units. One is noise radiated from the fans and compressors in the unit, and the second is excessive vibration of the building. Both of these conditions are affected by the roof structure, which in recent years has generally trended toward lighter and more compliant systems to reduce costs. The following paragraphs provide general recommendations for solving these problems. Specific details (such as roof construction, isolator design and deflection, isolator placement, unit location, and duct configuration) must be individually generated for each project.

The first and most important step to controlling both noise and vibration is the installation of vibration isolators between the unit and the roof structure. Deleting the vibration isolators will almost certainly cause excessive noise in the occupied space below (even with a heavy concrete roof deck) due to structure-borne sound transmission. For most systems some type of steel spring mount or spring isolation curb is adequate. Rubber mounts are usually inadequate. For very critical installations (such as above a hospital operating room) high efficiency air springs may be required. In order to make a proper isolator selection several factors must be known including fan speed (rpm), unit weight at each support point, and the vertical and horizontal stiffness of the supporting structure at the support points.


A properly selected and installed vibration isolation system will usually solve the structure-borne sound and roof vibration problems, but it will have no effect on the air-borne noise from the unit's fans and compressors. Air-borne noise generally follows three paths: 1) through the supply ductwork, 2) along the return air path, and 3) via direct radiation through the roof and suspended ceiling. All three of these potential sound paths must be checked in order to ensure a satisfactory installation.

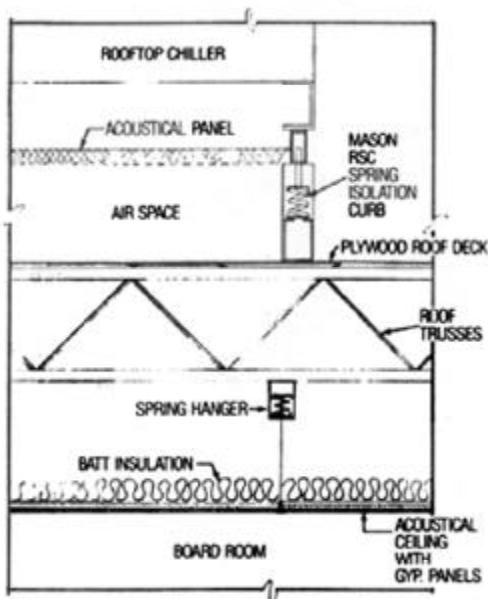

The specific requirements for controlling air-borne noise from rooftop units varies from project to project. Certain units are noisier than others, and selecting the quietest unit and locating it over non-critical space (i.e. a storage room or restroom) is usually the most effective and least expensive means of noise control. Prefabricated sound traps are sometimes required in the supply and return air ductwork, depending upon the duct layout and other details. The return air system is usually more critical than the supply air system because it is often unducted and exposed directly to the ceiling plenum of the occupied space.

Air-borne noise radiation through the roof can be a problem for light-weight roofing systems such as metal deck with rigid insulation and built-up roofing. Providing a concrete slab in the vicinity of the unit is usually required for larger air conditioning units. Radiated noise can also be reduced by installing a sound barrier of gypsum board or steel between the roof deck and the unit. The following example provides specific details from a recently completed project involving an existing rooftop refrigeration unit.

A large food distribution company in the Seattle area was expanding their offices inside a large warehouse, and they had already started construction on their own corporate boardroom when they discovered that the noise from three rooftop chillers (located on the roof directly above the boardroom) was intolerable. Inspection of the units revealed no vibration isolators, and the roof system was simply plywood decking with built-up roofing.

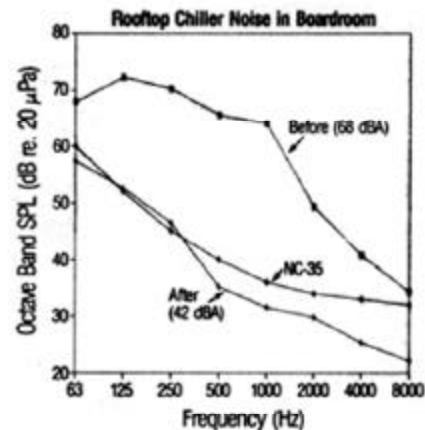

The noise and vibration measurements indicated that the structure-borne noise was about 15 dB greater than the air-borne noise, but both were well above the desired NC-35 level. A detail illustrating the recommended solution to the problem is shown at left. The rooftop units were remounted on top of a spring isolation curb manufactured by Mason Industries which was mounted directly to the existing roof deck. To control air-borne compressor noise, a 2" thick acoustical panel (attached to the spring isolation curb) was inserted under the compressors. A spring isolated suspended acoustical ceiling backed with gypsum panels and batt insulation completed the installation in the boardroom.

The measured results of this work are shown in the figure above. The original noise level in the boardroom (without a suspended ceiling) was NC-64 or 68 dBA. After completion of the specified work the noise level was reduced to NC-36 or 42 dBA with all three compressors running. Understandably, the owner is extremely pleased with the performance of the system.

The above information has been reviewed and is believed to be accurate, however we assume no responsibility for errors or omissions.